

*Please consult Aqua Mundus for specific models tested, certified and/or listed by these organizations.

Copyright ©2017 Aqua Mundus • 15 Waterloo Business Park Waterloo Road, Bidford on Avon, Warwickshire, B50 4JG emailus@aquamundus.co.uk

For additional information on Trapzilla or other Aqua Mundus products, please visit www.aquamundus.com or call at 08456 440 630

Installation & Maintenance Instructions For Trapzilla[®] Grease Interceptors



Contents

1.0 System Overview	4
2.0 Models and Options	5
2.1 In-Ground Models	5
2.2 Above-Ground Models	6
2.3 Basic Models	7
2.4 Options (Some options must be purchased separately)	8
3.0 Plumbing Installation	9
3.1 Plumbing Considerations Prior to Installation	9
3.1.1 Locating the Unit	9
3.1.2 Inlet/Outlet Piping	9
3.1.3 Flow Controls	9
3.1.4 Venting the Outlet	9
3.1.5 For High Head Height Applications Over Six (6) Feet (1.95 m)	9
3.2 Vessel Vent Connection	10
3.3 Plumbing Configurations	11
3.3.1 Installing One Trapzilla Unit	11
3.3.2 Installing Multiple Trapzilla Units in Parallel	12
3.3.3 Installing Two Trapzilla GI's in Series or One Solids Separator and One Trapzilla	13
3.3.4 One Solids Separator and Two Trapzilla Units	14
3.3.5 Two Solids Separators and Two Trapzilla Units	15
4.0 Above-Ground Installation	16
4.1 Components for Above-Ground Installations	16
5.0 In-Ground Installation	18
5.1 Plumbing Instructions for Single Trapzilla Installed In-Ground	18
5.2 Plumbing Instructions for Multiple Trapzilla Units Installed In-Ground	19
5.3 Trimming and Setting the ECA-TZ-18 Single-Piece Extension Collar	20
5.4 Concrete Calculations for TZ Models/Components	22
6.0 Hanging Installation	23

1.0 System Overview


The Aqua Mundus, Inc. Trapzilla[®] Supercapace gootained in kitchen drain water flows. As most food service facility managers already know, grease buildup inside a building's grease containment system is a major cause of problems due to exterior drain line blockages. These problems jeopardize normal operations as well as create health and safety hazards within the facility itself.

The proper installation of a Trapzilla® Supercapacity Grease Interceptor can reduce or eliminate grease problems and costly sewer surcharges and fines through efficient separation and retention of freefloating grease & oils.

The Trapzilla offers patented flat separation curve technology. This means that the unit does not lose grease separation efficiency as it fills with retained grease. Thus, the Trapzilla stores large quantities of grease without losing efficiency. The unique compact design of the Trapzilla allows for installation into most facilities. Options are available that enable a Trapzilla unit to be installed on the floor, suspended from the ceiling or in-ground outside the facility.

Trapzilla units are designed to treat high flows of kitchen drainwater with large grease storage capacity within a small footprint unit. These units are easy to maneuver into position and just as easy to plumb.

Grease interceptors, grease traps, automatic recovery units, grease removal devices and other similar plumbing devices receiving kitchen flows from sinks, floor drains, woks and other food bearing sources may generate odours. There are many factors influencing odor evolution and dissemination. These include room ventilation, kitchen menu, ambient temperatures, ware washing practices, grease/ oil input, daily input fluid volume, sanitizers, installation plumbing design and product maintenance/ upkeep. odours are usually prevented by good area ventilation, frequent fluid inputs, good product maintenance practices and proper product installation. Additional steps, including aeration, chlorination, pH control, improved area ventilation and additional maintenance may be needed at some sites.

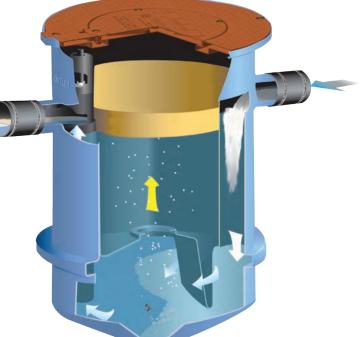

The Aqua Mundus, Inc. Trapzilla® Supercapacity Grease Interceptor collects free-floating grease

rloo Business Park Waterloo Road, Bidford on	AFE
JG emailus@aquamundus.co.uk	MNL-TZ 4



2.0 Models and Options

Thermaco offers different models and options specifically designed to assist the owner/installer meet site conditions while complying with local pretreatment and plumbing code.

2.1 In-Ground Models

TZ-600-ECA

635 pounds of grease storage, ASME rated at 75 gpm, while hydromechanically capable of flow rates of up to 150 gpm. Equipped with 4" inlet/outlet, 2" vessel vent connection, and 4" Low-Head Flow Control Accessory to limit flow to 75 gpm.

Comes with: 18" tall Extension Collar Adapter Lid Assembly with 22" diameter lid.

*Model available with 6" Inlet/Outlet, add suffix -6 to model.



TZ-400-ECA


405 pounds of grease storage, ASME rated at 75 gpm. Equipped with 4" inlet/outlet, 2" vessel vent connection, and 4" Low-Head Flow Control Accessory to limit flow to 75 gpm.

Comes with: 18" tall Extension Collar Adapter Lid Assembly with 22" diameter lid.

TZ-160-ECA

167 pounds of grease storage, ASME rated at 35 gpm. Equipped with 3" inlet/outlet, 2" vessel vent connection, and 3" Low-Head Flow Control Accessory to limit flow to 35 gpm.

Comes with: 22" diameter lid and 29" Telescoping Extension Collar.



2.2 Above-Ground Models

TZ-600-SSA

635 pounds of grease storage, ASME rated at 75 gpm, while hydromechanically capable of flow rates of up to 150 gpm. Equipped with 4" inlet/outlet, 2" vessel vent connection, and 4" Low-Head Flow Control Accessory to limit flow to 75 gpm.

Comes with: Standard Adapter Top Cover with 22" diameter lid, and Support Stand SSOP-400/600.

*Model available with 6" Inlet/Outlet, add suffix -6 to model.

TZ-400-SSA

405 pounds of grease storage, ASME rated at 75 gpm. Equipped with 4" inlet/outlet, 2" vessel vent connection, and 4" Low-Head Flow Control Accessory to limit flow to 75 gpm. Comes with: Standard Adapter Lid Ring with 22" diameter

lid, and Support Stand SSOP-400/600.

TZ-160-SSA

167 pounds of grease storage, ASME rated at 35 gpm. Equipped with 3" inlet/outlet, 2" vessel vent connection, and 3" Low-Head Flow Control Accessory to limit flow to 35 gpm.

Comes with: 22" diameter lid and Support Stand SSA-160.







loo Business Park Waterloo Road, Bidford on	AFE
G emailus@aquamundus.co.uk	MNL-TZ 6



2.4 Options (Some options must be purchased separately)

2.3 Basic Models

TZ-600

635 pounds of grease storage, ASME rated at 75 gpm, while hydromechanically capable of flow rates of up to 150 gpm. Equipped with 4" inlet/outlet, 2" vessel vent connection, and 4" Low-Head Flow Control Accessory to limit flow to 75 gpm.

Comes with: Standard Adapter Lid Ring with 22" diameter lid.

*Model available with 6" Inlet/Outlet, add suffix -6 to model.

TZ-400


405 pounds of grease storage, ASME rated at 75 gpm. Equipped with 4" inlet/outlet, 2" vessel vent connection, and 4" Low-Head Flow Control Accessory to limit flow to 75 gpm.


Comes with: Standard Adapter Lid Ring with 22" diameter lid.

TZ-160

167 pounds of grease storage, ASME rated at 35 gpm. Equipped with 3" inlet/outlet, 2" vessel vent connection, and 3" Low-Head Flow Control Accessory to limit flow to 35 gpm.

Comes with: 22" diameter lid.



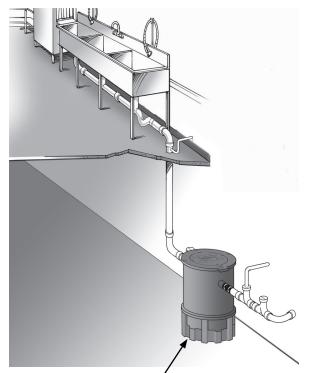


SSOP-400/600 Support Stand for TZ-400 and TZ-600 models Allows unit to be installed directly on the floor in a basement or mechanical room. *Included with -SSA Models

ECA-TZ-29 (in blue) for Trapzilla Models

These field-modifiable extension collars available to provide additional depth for existing kitchen drainage piping.

-ECA Models ship with built-in 0-18" extension collar. ECA-TZ-29 adds 0-29" depth to -ECA Models or 4-29" to Basic Models.



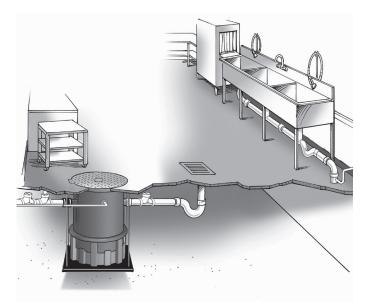


FTCA-36

Fabricated Top Cover Assembly with 36" diameter for additional traction in high foot-traffic areas and 4" Brass cleanout port.

FTCA-22 (not shown)

22" diameter cover available for In-Ground installations.

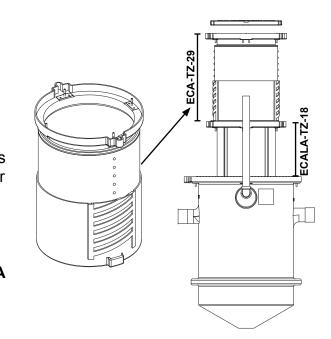

rloo Business Park Waterloo Road, Bidford on	AFE	
JG emailus@aquamundus.co.uk	MNL-TZ 8	



3.0 Plumbing Installation

3.1 Plumbing Considerations Prior to Installation

3.1.1 Locating the Unit

The system should be visible and easily accessible for maintenance and inspection. Options are available to install the Trapzilla in a basement, suspended from a ceiling or in-ground in an exterior location. Make sure adequate room is provided around the unit to allow easy access for a pump truck operator. Make sure the height above the Trapzilla access cover is enough to properly service the system.

3.1.2 Inlet/Outlet Piping

The inlet and outlet piping connections require flexible sleeve pipe couplings. Keep outlet piping as straight as possible. Thermaco, Inc. recommends installation of Two-Way Cleanouts on both the Inlet and Outlet of Trapzilla Interceptors and Solids Separators in accordance with all applicable laws, regulations and codes. These cleanouts should match the size of the Inlet and Outlet Piping (i.e. for 4" plumbing, a 4" cleanout should be used). Use only "sweep" connections. Do not reduce the pipe sizing on the outlet piping. Do not install "P" trap on outlet connection of system. (Note: The system already has a internal gas trap)

3.1.3 Flow Controls

Trapzilla systems are supplied with a Low-Head Flow Control module (LHFC). This should be connected to the inlet of the Trapzilla unit in situations where flow rate needs to be restricted to the ASME rated flow or when vented flow control is required by local code.

3.1.4 Venting the Outlet

An outlet vent or approved air admittance valve of at least 1/2 the diameter of the system's outlet connection must be present as close as possible to the Trapzilla outlet to prevent possible siphonage problems. The Vent on the Outlet piping is to be installed in accordance with all applicable laws, regulations and codes. Failure to provide a vent for the system voids Thermaco's Limited Warranty for the system.

3.1.5 For High Head Height Applications Over Six (6) Feet (1.95 m)

For installations where there is head height of greater than 6 feet (1.95 meters), Thermaco, Inc. recommends installation of a code-approved Vented Flow Control Assembly (Thermaco VFCA not included with Trapzilla).


3.2 Vessel Vent Connection

Venting of the Trapzilla tank is recommended by the manufacturer and required for indoor installations.

• Vent the tank through the provided 2" NPT threaded connector on the side of the tank (This vent may be located above the outlet or on the side of the tank depending on model).

Remove and discard the 2" plug and connect 2" vent lines as indicated below.

**Models with 6" Inlet/Outlet have 3" NPT vessel vent

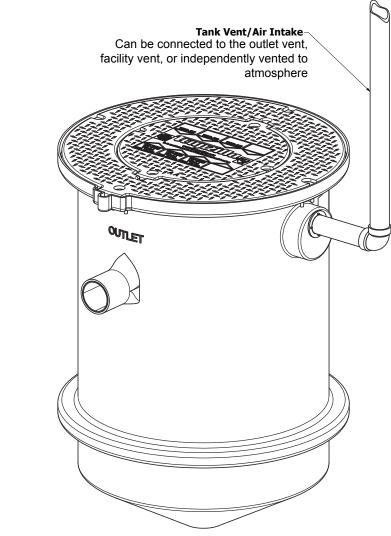

Note: Drawing for reference only. Equipment must be installed in compliance with all applicable laws, regulations and codes, including plumbing codes. Installation should be performed by a qualified plumber.


rloo Business Park Waterloo Road, Bidford on	AFE
G emailus@aquamundus.co.uk	MNL-TZ 10



3.3 Plumbing Configurations


3.3.1 Installing One Trapzilla Unit

Each Trapzilla unit is shipped with a Low Head Flow Control module (see LHFC box for additional instructions). This needs to be installed to the inlet of the Trapzilla and connected to a code-approved air intake. Thermaco, Inc. recommends installation of Two-Way Cleanouts on both the Inlet and Outlet of Trapzilla[®] in accordance with all applicable laws, regulations and codes. **These cleanouts should match the size of the Inlet and Outlet Piping (i.e. for 4" plumbing, a 4" cleanout should be used).** A Vent on the Outlet piping is also to be installed in accordance with all applicable laws, regulations and codes.

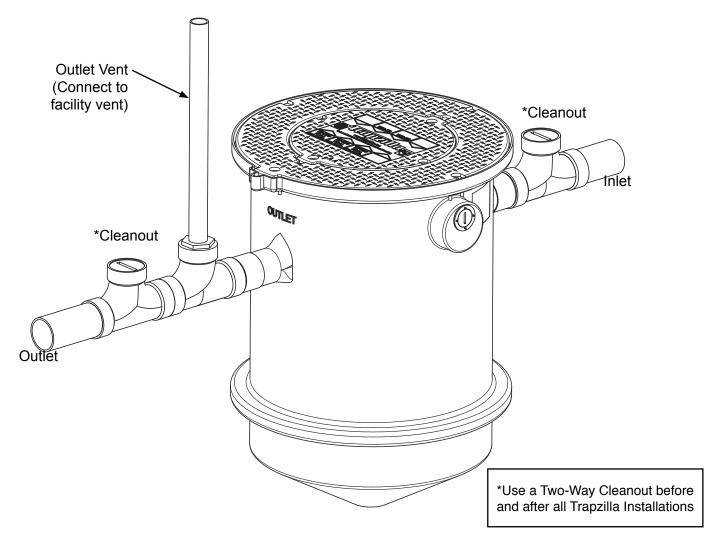

3.3.2 Installing Two Trapzilla Units in Parallel

Two Trapzilla Grease Interceptors should be installed in parallel with a Flow Splitter diverting the flow. Place Two-Way Cleanouts before, between and after the units as shown below, including before and after the flow splitter. Make sure to connect an outlet vent after each Trapzilla Grease Interceptor. A Low Head Flow Control (LHFC) is shipped with each unit, and if needed should only be installed after the first Cleanout and before the Flow Splitter.

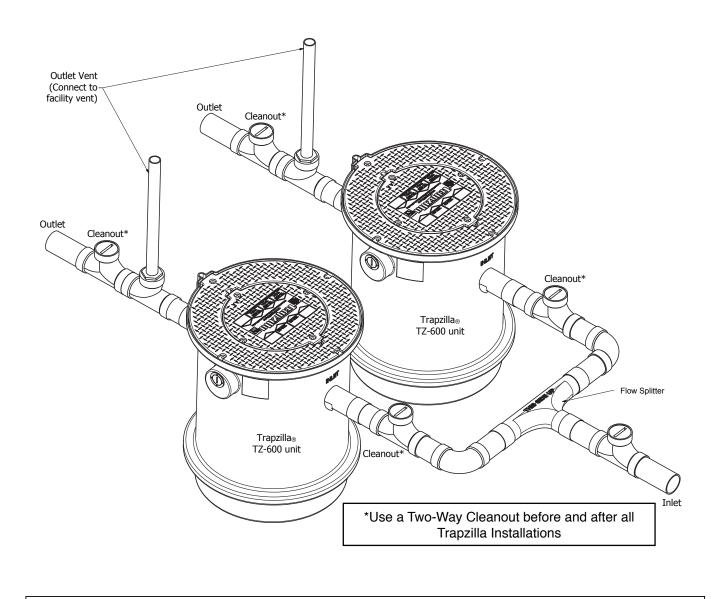

Note: Drawing for reference only. Equipment must be installed in compliance with all applicable laws, regulations and codes, including plumbing codes. Installation should be performed by a qualified plumber.

Note: Drawing for reference only. Equipment must be installed in compliance with all applicable laws, regulations and codes, including plumbing codes. Installation should be performed by a qualified plumber.

rloo Business Park Waterloo Road, Bidford on	AFE
G emailus@aquamundus.co.uk	MNL-TZ 12




3.3.3 Installing Two Trapzilla GI's in Series or One Solids Separator and One Trapzilla

Alternatively, two Trapzilla Grease Interceptors may be installed in series. A single Trapzilla Solids Separator and Trapzilla Grease Interceptor should always be installed in series. Place Two-Way Cleanouts before, between and after the units as shown below. Make sure to connect an outlet vent after the Trapzilla Grease Interceptor. A Low Head Flow Control (LHFC) is shipped with each unit, and if needed should only be installed after the first Cleanout and before the Trapzilla Solids Separator.

3.3.4 One Solids Separator and Two Trapzilla Units

A single Trapzilla Solids Separator and two Trapzilla Grease Interceptors should be installed by placing the Solids Separator in line and then using a Flow Splitter to divert the water flow to two separate Trapzilla units in parallel. Place Two-Way Cleanouts before, between and after the units as shown below, including before and after the flow splitter. Make sure to connect an outlet vent after the Trapzilla Grease Interceptor. A Low Head Flow Control (LHFC) is shipped with each unit, and if needed should only be installed after the first Cleanout and before the Trapzilla Solids Separator.

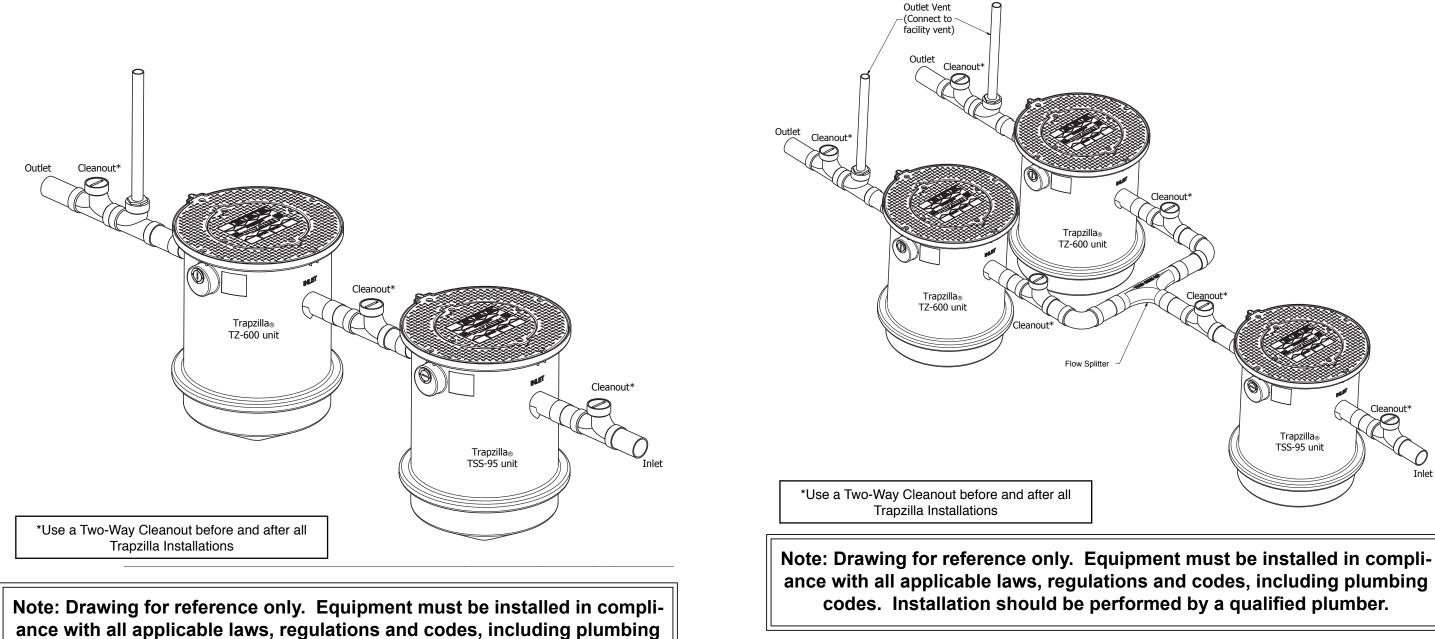

codes. Installation should be performed by a qualified plumber.

rloo Business Park Waterloo Road, Bidford on	AFE	
G emailus@aquamundus.co.uk	MNL-TZ 14	



3.3.5 Two Solids Separators and Two Trapzilla Units

Two Trapzilla Solids Separator and two Trapzilla Grease Interceptors should be installed by placing a Flow Splitter to divert the water flow to two separate Solids Separators and Trapzilla units in parallel. Place Two-Way Cleanouts before, between and after the units as shown below, including before and after the flow splitter. Make sure to connect an outlet vent after the Trapzilla Grease Interceptor. A Low Head Flow Control (LHFC) is shipped with each unit, and if needed should only be installed after the first Cleanout and before the Flow Splitter.

4.0 Above-Ground Installation


4.1 Components for Above-Ground Installations

Using a model-specific Support Stand, a Trapzilla unit may be installed directly on top of the floor in a location such as a basement or mechanical room.


TZ 400 or TZ-600: SSOP-400/600

TZ-160: SSA-160

*These items ship with all -SSA models.

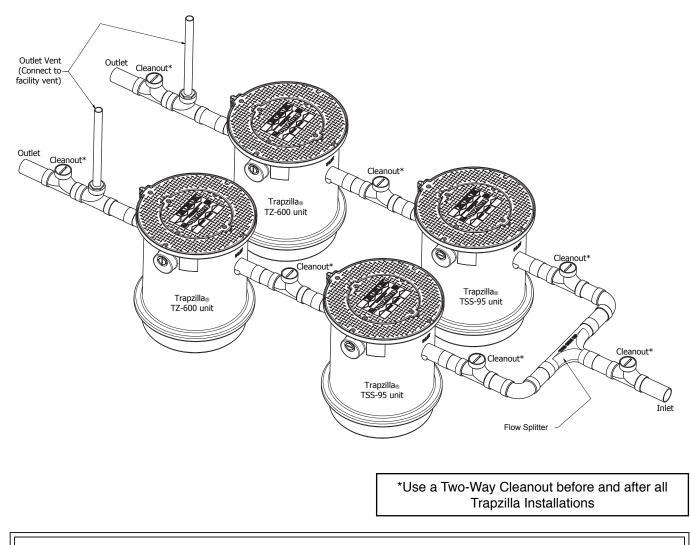

Note: Drawing for reference only. Equipment must be installed in compliance with all applicable laws, regulations and codes, including plumbing codes. Installation should be performed by a qualified plumber.

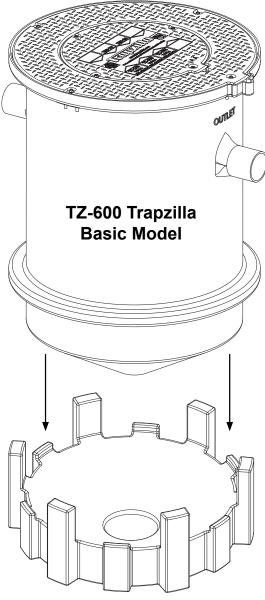

The SSOP Support Stand is a one-piece assembly with a conical center that sits on the floor. It does not add appreciable height to the assembly.

NOTE: SUPPORT STAND MUST BE INSTALLED OVER A CONTINUOUS SURFACE. NON-CONTINUOUS SUR-FACES SUCH AS GRATES ARE NOT SUITABLE FOR SUPPORT.

SSOP-400/600 Support Stand


rloo Business Park Waterloo Road, Bidford on	AFE
IG emailus@aquamundus.co.uk	MNL-TZ 16



4.2 Installing Multiple Trapzilla Units in Series

When installing multiple Trapzilla units in series, the change in elevation from the inlet to the outlet of a unit requires that each preceding unit be installed 1" higher than the unit after it. For above-ground units, pressure treated plywood may be placed fully beneath the support stand to create the height difference.

All installations inside of a building must have a vessel vent installed and piped to atmosphere.

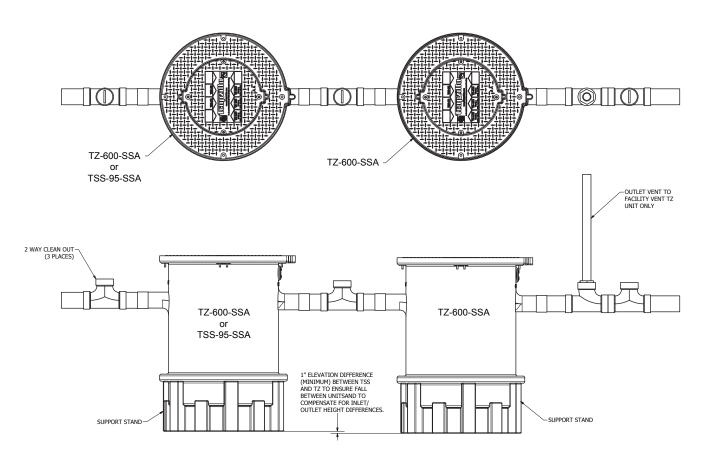


5.0 In-Ground Installation

5.1 Plumbing Instructions for Single Trapzilla Installed In-Ground

A Trapzilla unit may also be installed in the ground outside of the facility. For instances where the facility drainage piping requires an extension collar that is no more than 18", use the instructions for the full TZ-600-ECA unit. If the unit is to be deeper in the ground, the ECA-TZ-29 Extension Collar Assembly may be installed to align the Trapzilla inlet with the drainage piping. The ECA-TZ-29 may be trimmed in the field to fit. Trim both the inner and outer portions of the extension collar to make shorter than collapsed height. Thermaco, Inc. strongly recommends surrounding the in-ground Trapzilla with concrete to provide additional structural strength and to offset buoyancy effects. For Buoyancy Calculations & suggested concrete fill quantities please see page 22. Use the full TZ-600-ECA for 0-18" of collar needed or purchase separately the TZ-600 and ECA-TZ-29 for 4-29" of collar needed.

In-Ground Installations inside of a building must have a vessel vent installed and piped to atmosphere.

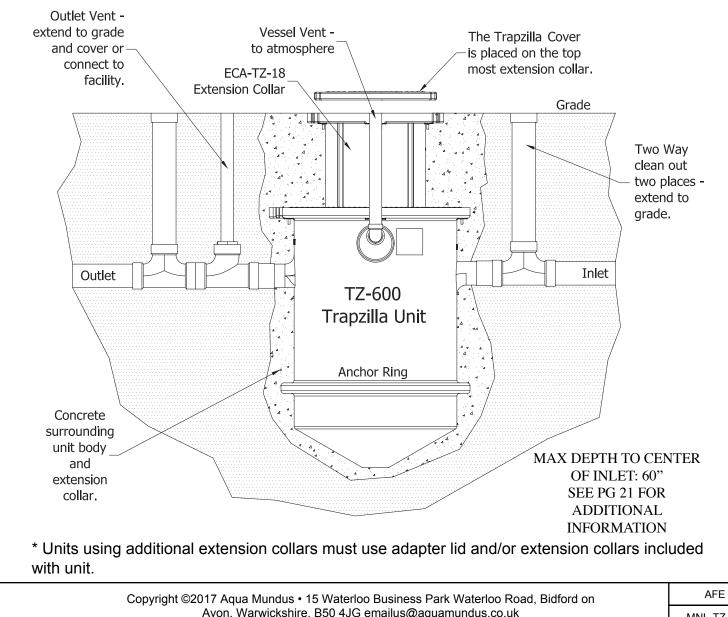


loo Business Park Waterloo Road, Bidford on	AFE
G emailus@aquamundus.co.uk	MNL-TZ 18



5.2 Plumbing Instructions for Multiple Trapzilla Units Installed In-Ground

When installing multiple Trapzilla units in series, the change in elevation from the inlet to the outlet of a unit requires each preceding unit to be installed 1" higher than the unit after it.

In-Ground Installations inside of a building must have a vessel vent installed and piped to atmosphere.

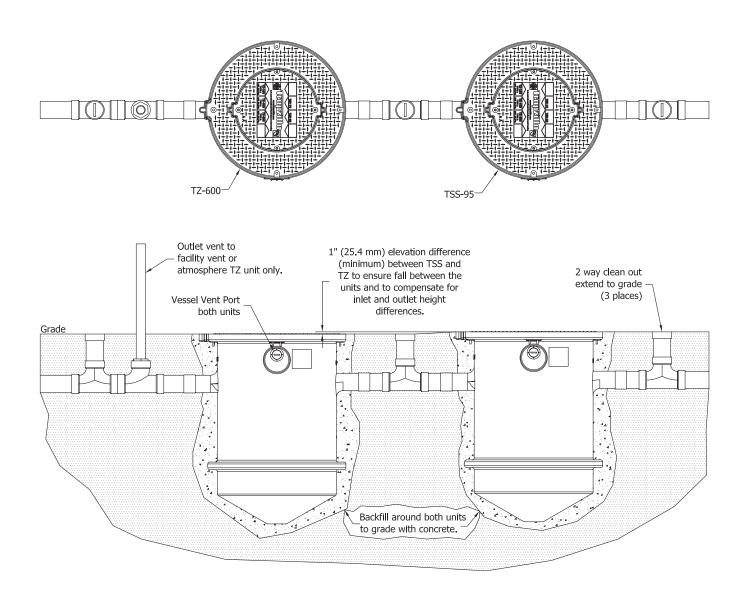

* Units using additional extension collars must use adapter lid and/or extension collars included with unit.


5.3 Trimming and Setting the ECA-TZ-18 Single-Piece Extension Collar


In-Ground Trapzilla Models ship with a built-in, single-piece, 18" extension collar that must be trimmed and then set to the correct height to bring the Solid Top Cover to grade.


Follow the steps below to set the extension collar prior to backfilling the hole with concrete.

Step 1: With the Trapzilla unit installed in its perma-Step 2: Remove the extension collar adapter ring from the unit with the extension collar still in place. On the underside of the cover, mark the excess extension collar length at the bottom of the four (4) "skirt" portions of the adapter ring. Check the extension collar height dimension frequently during this marking to ensure that the collar has not moved. Extend this mark between the gaps in the "skirt" so that the collar is marked all around.

nent location, raise the telescoping extension collar to finished grade or floor level. Measure the height from the top of the unit to this finished extension collar height and record this dimension. Note: If the floor will have a tile covering alow for the tile thickness when determining the extension collar height

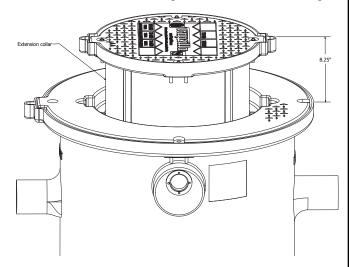

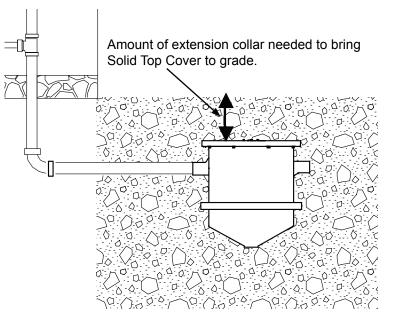


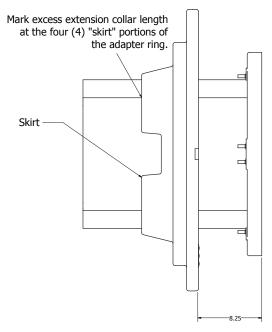


rloo Business Park Waterloo Road, Bidford on	AFE	
IG emailus@aquamundus.co.uk	MNL-TZ 20	




Step 3: Remove the extension collar from the adapter ring and, with an appropriate saw, cut along the line created in Step 2 to remove the excessive extension collar.

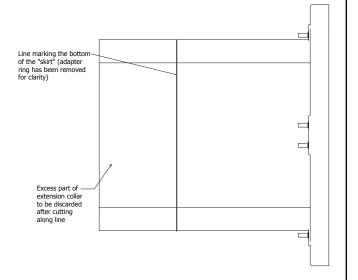


Step 4: Reinsert the extension collar into the adapter ring ensuring that the cover alignment key on the extension collar is aligned with its recess in the adapter ring. Reset the extension collar height to the dimension determined in Step 1.

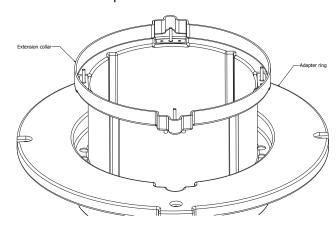

Step 5: Working from the bottom of the assembly, install eight (8) self-drilling, self-tapping screws (provided) through the extension collar wall and into the adapter ring. Two of these screws should be installed in each of the four (4) skirt areas of the adapter ring. Check the extension collar height dimension frequently during this operation to ensure that the collar has not moved. Note: Use caution when tightening these screws to ensure that they do not strip.

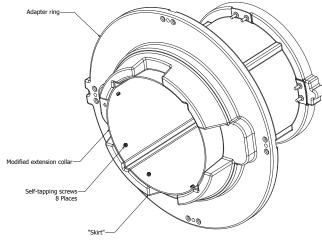


Step 6: Place the adapter ring/extension collar assembly onto the Trapzilla unit. Position the small cover onto the extension collar. Secure the adapter ring and the small cover with the brass nuts and flat washers provided. Seal the gap between the 18" extension collar and extension collar adapter ring using a silicone sealant.

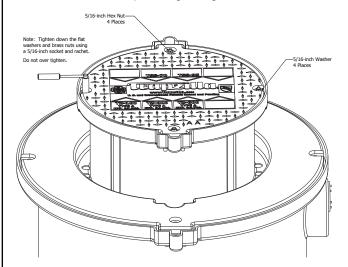

5.4 Concrete Calculations for TZ Models/Components

In order to offset the effects of buoyancy caused by groundwater (high water tables), strengthen the sideload of the unit, and prevent movement of the unit in the event of shifting earth, Thermaco, Inc. recommends concrete be poured around the entirety of Trapzilla® units installed in-ground in the amounts of concrete specified in the table below. The concrete must to be poured continuously and completely surrounding the Trapzilla[®] body (and Extension Collars if applicable) to ensure proper strength and security at a compression strength of 4000 psi (C28/35).

	Amount of Concrete	
Trapzilla Model	Weight in lbs. (Kg)	Volume in Cubic Yards (m ³)
TZ-600	1975 (895)	0.50 (0.38)
TZ-400	1525 (691)	0.40 (0.31)
TZ-160	550 (249)	0.15 (0.11)
ECA-TZ-29*	600	0.20

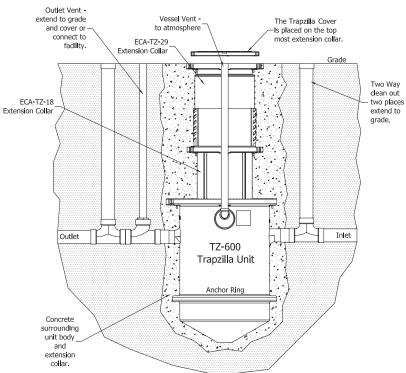



Pictured Left:

Installation of TZ-600-ECA unit with Built-In 18" Extension Collar fully extended and 29" Two-Piece Extension Collar fully extended for a total of 47" of additional depth for unit. Concrete should fully encircle the unit up to the surface. A small amount of space (up to 4") may be left unfilled to cover with dirt and grass if installed outside.


WARNING: PROPER INSTALLA-TION INSTRUCTIONS MUST BE FOLLOWED FOR THERMACO WAR-RANTY TO BE VALID. MAXIMUM **INSTALLATION DEPTH PERMITTED** FOR TRAPZILLA GREASE INTER-**CEPTORS AND SOLIDS SEPARATORS IS 60" MEASURING FROM CENTER OF INLET TO SURFACE.** ANY INSTAL-LATION DEEPER THAN THIS VOIDS THE WARRANTY FOR THE UNIT. CONTACT THERMACO REGARDING INSTALLATIONS EXCEEDING THIS DEPTH.

rloo Business Park Waterloo Road, Bidford on	AFE
G emailus@aquamundus.co.uk	MNL-TZ 22



6.0 Hanging Installation

Using the Hanging Assembly option, a Trapzilla unit may be suspended from a ceiling below the floor of a kitchen or other room.

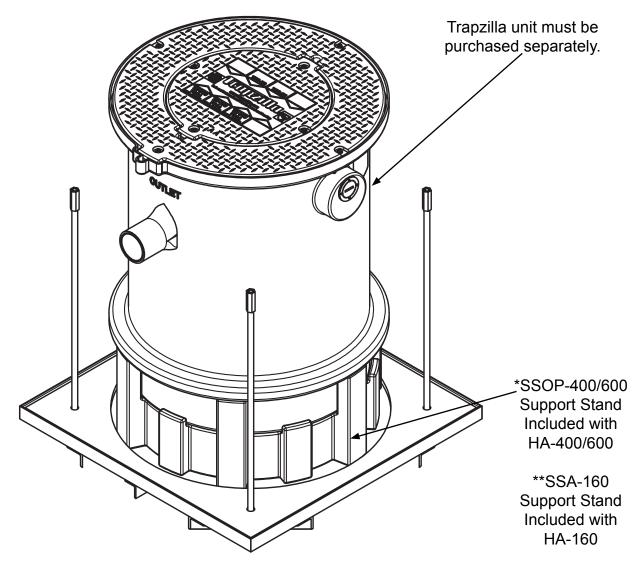

Thermaco, Inc. supplies the frame and support stand with the hanging assembly. This kit needs to be installed by a licensed contractor. The contractor is responsible for determining weight loads, preparation of the floor for installation and any construction necessary for installation of the suspension kit.

Note: Drawing for reference only. Equipment must be installed in compliance with all applicable laws, regulations and codes, including plumbing codes. Installation should be performed by a qualified plumber.

7.0 Measuring Grease/Solids Levels

Due to its unique design, Trapzilla is capable of retaining high quantities of grease in a compact footprint. Therefore, unlike traditional interceptors, Trapzilla can hold an extraordinarily high percentage of its volume in grease without losing separation efficiency. To determine the current levels of grease/solids in your Trapzilla grease interceptor, follow the instructions below.


1. Remove four nuts/washers securing the Solid Top Cover. Note the size of the unit which is marked on the cover by a metal plate.

2. Place a grease/sludge dipstick into the center of the Trapzilla, making sure that it goes through the hole in the horizontal baffle.

3. Once the dipstick has found its natural resting place at the lowest point in the conical shaped bottom, take the measurement.

4. Remove dipstick and compare grease/sludge levels to the corresponding unit in the charts below.

	Grease		Solids	
	Total Capacity (depth):	Ready to pump at (depth):	Total Capacity (height):	Ready to pump at (height):
TZ-600	17"	13.75"	14"	12"
TZ-400	9.375"	7.5"	14"	12"
TZ-160	13"	10.5"	10"	8"

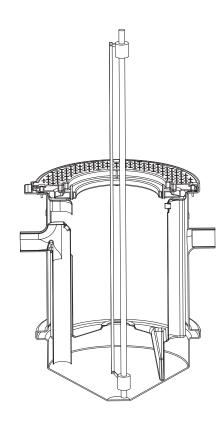

Take grease measurement from top of liquid level downward and compare to chart above.


Take solids/sludge measurement from bottom of unit upward and compare to chart above.

loo Business Park Waterloo Road, Bidford on	AFE
G emailus@aquamundus.co.uk	MNL-TZ 24




8.0 Unit Maintenance

Periodically, the Trapzilla[®] unit will need to be serviced which involves pumping out the accumulated grease & solids. Each lid has four brass nuts securing the lid. Fully remove the lid to access the grease. Begin by taking the grease from the top of the main chamber. Upon reaching the horizontal baffle, you will see a hole through which you may access the rest of the grease and the solids. Be sure to lower the hose all the way to the bottom of the Trapzilla unit so that solids may be entirely removed.




Note:

- 1. DO NOT use mechanical crust breaking devices to break down any mat that has formed inside the Trapzilla unit.
- 2. Remove the four brass nuts from the bolts and fully remove the lid to pump out.
- 3. It is not necessary to remove adapter lid (ring) to pump out Trapzilla.
- 4. If necessary, use a water hose with spray nozzle to rinse off inside of unit.
- 5. DO NOT use grinding augers in maintenance of the Trapzilla unit.

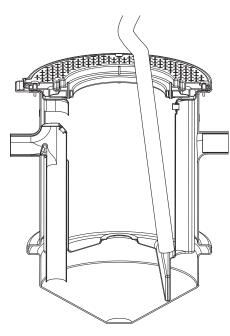

Begin by pumping grease from upper chamber, until you can see the entire horizontal baffle. May be necessary to use water hose to rinse out parts of upper chamber.

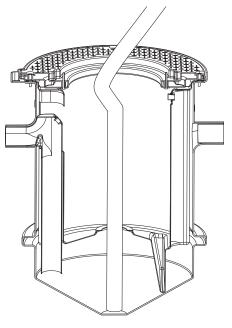

Drop hose into lower chamber through hole in horizontal baffle, pumping out all liquids and solids remaining. Again, it may be necessary to use water hose to rinse out lower chamber.

9.0 Limited Warranty and Remedy

Agua Mundus, Inc. warrants to the original user that the equipment manufactured by Agua Mundus and deliv-ered with this warranty (the "Product") shall be free from material defects in workmanship and materials during the lifetime of the plumbing system in which the Product is initially installed.

Any claim under this warranty must be made in writing to Agua Mundus at 646 Greensboro Street, Ashe-boro, NC 27203 promptly after discovery of the defect and the Product must be delivered, prepaid, to Agua Mundus, together with proof of purchase and a return authorization number issued by Agua Mundus. If Agua Mundus determines that the Product is defective. Thermaco's sole obligation, and the purchaser's sole and exclusive remedy, is the repair or replacement, at Thermaco's option, of the defective Product.

This warranty shall not cover any defect or damage resulting directly or indirectly from: (i) failure to properly install, operate or maintain the Product in accordance with Thermaco's instructions, including, without limitation, use in excess of rated flow, installation deeper than manufacturer's recommendation or in conjunction with unapproved components, use to remove emulsified fats and oils or use that fails to comply with applicable laws, regulations or codes; (ii) damage in transit, handling or installation; (iii) modifications, adjustments, or alterations of the Product; (iv) disassembly of components other than as required for prescribed maintenance; or (v) any other causes not arising out of defects in workmanship or materials. Agua Mundus shall not be responsible for damage to Products resulting from ultraviolet light exposure, vault flooding, sewer line back-up, pumping or lift station failure, ambient water flow, freez-ing, or other sources of water damage. Costs for any service, adjustment, removal, repair, packing, or otherwise incurred with respect to the Product prior to submission for warranty are the responsibility of purchaser.

No distributor, sales representative or other person is authorized to make any warranty statements on behalf of Aqua Mundus regarding Products other than as provided herein. This statement of warranty su-persedes any quote, brochure, or other statement or document with respect to warranty of Aqua Mundus products.

EXCEPT AS EXPRESSLY SET FORTH ABOVE, Agua Mundus MAKES NO REPRESENTATIONS, WARRANTIES OR GUARANTEES, EITHER EXPRESSED OR IMPLIED, INCLUDING, WITHOUT LIMITATION, AS TO MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE, WHETHER OR NOT Agua Mundus HAD KNOWLEDGE OF PURCHASER'S PARTICULAR REQUIREMENTS OR NEEDS, OR WITH RESPECT TO odour GENERATION OR OTHER INCIDENTALS RELATING TO USE OF THE PRODUCT.

The sole and exclusive remedy with respect to this warranty or any other claim relating to defects or any other condition or use of Products, however caused, and whether such claim is based upon warranty, contract, tort, strict liability or any other theory, is LIMITED to the repair or replacement of the Product, excluding any cost to remove or install the Product or, at Thermaco's option, repayment of the pur-chase price. IN NO EVENT SHALL Agua Mundus BE LIABLE, WHETHER IN CONTRACT, WARRAN-TY, TORT (INCLUDING NEGLIGENCE), STRICT LIABILITY, INDEMNITY OR ANY OTHER LEGAL THEORY, FOR INCIDENTAL OR CONSEQUENTIAL DAMAGES. UNDER NO CIRCUMSTANCES WILL THE AGGREGATE LIABILITY OF Agua Mundus FOR ANY CAUSE OF ACTION RELATED TO THE PRODUCT COVERED HEREBY EXCEED THE NET PURCHASE PRICE RECEIVED BY THER-MACO FOR THE PRODUCT.

Note: Do not Pressure/Hydrostatic test our units.

rloo Business Park Waterloo Road, Bidford on	AFE
IG emailus@aquamundus.co.uk	MNL-TZ 26